

Type No. _____
Job Name _____
Catalog No. _____



Shown: LB300



Shown: LB600

Centaurus Linebacker

**300-600 Watts, Sine Wave
Fast Transfer Power Supply for
Emergency Lighting Applications**

Electronics

Input

- 120 or 277 VAC
- Frequency 60.0 Hz \pm 2.0%
- Input Voltage Tolerance \pm 10%
- Input circuit breaker

Output

- Solid state PWM inverter with sine wave output
- Output distortion <3% THD (linear load)
- Output fusing standard, circuit breakers optional
- Output frequency 60 Hz \pm 2 Hz
- Load power factor capability is 0.5 lagging to 0.5 leading
- Overload rating: 150% for 5 seconds
- Efficiency: 98%

Charger

- Low voltage disconnect (LVD)
- Fully automatic, temperature compensated
- Recharge time: UL 924 compliant
- Battery circuit breaker

Battery

- Maintenance free, sealed lead calcium battery with an expected life up to 10 years, and optimum operating range of 68°F (20°C) to 85°F (30°C)*

* Increases or decreases in temperature will affect battery performance. Optimum battery performance realized at 77°F (25°C). Batteries are rated at 100% capacity at 77°F (25°C).

Warranty

- Electronics: 3 years full
- Battery: 1 year full, 9 years pro-rata
- Extended warranty options available

Overall Characteristics

- 98% throughput efficiency
- Single conversion UPS, 1ms transfer time
- Operating temperature range of 68°F (20°C) to 85°F (30°C) for batteries
- Standard 90 minutes minimum of operating time at full load
- Pulse width modulated (PWM) design

Application

- Operates incandescent, electronic ballast loads and HID lighting loads as well as critical loads requiring conditioned emergency power. The Centaurus Linebacker is a Made in the USA product.

Housing

- Free standing, NEMA 1 enclosure
- Acid resistant powder coat finish
- Multiple conduit entries
- Refer to chart on back for dimensions

Standard Metering/Controls

- AC input breaker
- AC output fuse
- Battery disconnect breaker
- LED indicating lamps for system on utility, system on inverter, overload condition, no load connected

Centaurus Linebacker, 300-600 Watts

Ordering Information

FACTORY INSTALLED OPTIONAL CIRCUIT BREAKER

SERIES	OUTPUT WATTAGE	VOLTAGE CONFIGURATION	OUTPUT CIRCUIT BREAKERS	OUTPUT CIRCUIT BREAKER VOLTAGE*	OUTPUT CIRCUIT BREAKER RATING
LB = Centaurus Linebacker	300 = 330 VA / 300 Watts 400 = 660 VA / 400 Watts 600 = 660 VA / 600 Watts	120 = 120V 277 = 277V	1 = OCB1 2 = OCB2	A = 120 VAC R = 277 VAC	10 = 10 Amps 15 = 15 Amps 20 = 20 Amps

* Output circuit breaker voltage must match the system input voltage.

System Input/Output Ratings


MODEL	CAPACITY	INPUT (select one)	
		AC INPUT VOLTAGES	INPUT AMPS ¹
LB300	300W	120:277	3.1:1.4
LB400	400W	120:277	5.8:2.6
LB600	600W	120:277	6.2:2.8

NOTES:

1) Maximum input current


Dimensions/Weights

LB300, LB400

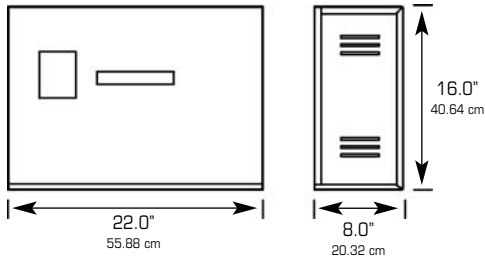

	300W	400W	600W
Cabinet & Batteries	113 lbs. (51.26 kg)	132 lbs. (59.87 kg)	188 lbs. (85.28 kg)

LB600

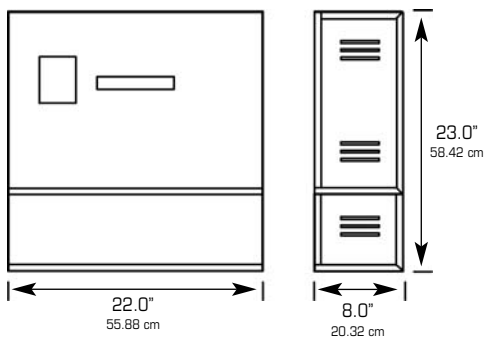

ALL SPECIFICATIONS SUBJECT TO CHANGE WITHOUT NOTICE



272 West Stag Park Service Road • Burgaw, NC 28425
(910) 259-1131 • FAX (800) 403-6927
www.lightguard.com

L2156R1
(Page 2 of 3) 3/10 IH



Centaurus Linebacker, 300-600 Watts

Suggested Specification

Furnish and install LightGuard's Emergency Lighting System known as Centaurus Linebacker with a capacity rating of _____ watts for a minimum of 90 minutes. The system shall produce a sine wave output, and shall be UL listed to Underwriters Laboratories standard 924 and FCC Class A compliant.

Equipment and accessories furnished under the terms of this specification shall be the standard product of a single manufacturer and shall be equal in all respects to those supplied by LightGuard. Catalog numbers and model designations which appear herein indicate design, quality and the type of material as well as required operating characteristics. All equipment shall be in compliance with the applicable UL standards, local and national codes.

The connected load shall be powered normally by utility through the Linebacker Inverter and upon failure of the utility input, the load shall automatically continue to be powered via the Centaurus Linebacker system's battery and inverter for a minimum of 1.5 hours. Upon restoration of utility power, the inverter will automatically reconnect the load to the utility power.

The Centaurus Linebacker system shall be capable of powering any combination of fluorescent ballasted lamps, HID, incandescent lamps or other approved loads up to the total rating of the system. The system shall automatically protect itself against damage from overloads and short circuits while powered from either utility AC or during emergency inverter operation.

The Centaurus Linebacker system shall automatically revert to emergency inverter operation should the average utility AC voltage fall below 80% of nominal line voltage. The system shall use no relays or other moving parts in the main inverter or battery charger circuitry. The power inverter shall be off except during a power failure.

Under inverter emergency operations, output voltage shall be within $\pm 2\%$ of nominal at full static load for the specified discharge period; and the frequency shall be 60.0 Hz \pm 2 Hz.

During inverter emergency operation, the system efficiency shall not be less than 80%. The AC output to the load shall be isolated from the utility input during inverter emergency operation.

The LightGuard Linebacker inverter battery charger shall be completely automatic, transistor controlled with a programmed reference, and capable of restoring the battery to capacity within UL 924 requirements after restoration of utility power. The charger power shall be obtained from the main power, via independent transformer. The charger efficiency shall not be less than 90%. The charger shall be all solid state, and shall automatically maintain the battery in the fully charged condition whenever the utility power is available.

Under emergency mode conditions, the Centaurus Linebacker Inverter shall be powered by sealed, maintenance-free recombination batteries. The sealed lead calcium battery shall be encased in a high impact, heat resistant, plastic container with a permanently sealed cover. The battery shall operate entirely unattended and require no addition of water for a period of 10 years.

A low voltage disconnect circuit designed to reduce battery discharge during extended power outages, shall monitor the battery voltage and disconnect the inverter when battery voltage drops to approximately 85% of nominal battery voltage.

System metering and controls shall consist of AC input, output and load status indicator lamps. AC input breaker, battery circuit breaker and push to test switch are included.

Unit Check List

Catalog No. _____	Wattage Rating: _____
Battery Type: Sealed Lead Calcium	Operating Time Hrs. <u>1</u> Min. <u>30</u>
Input: _____ VAC; <u>Single</u> Phase;	# of Wires <u>2</u>
Output: _____ VAC; <u>Single</u> Phase;	# of Wires <u>2</u>
Output Circuit Breakers:	
(1) AC Volts*: _____	Amps: _____
(2) AC Volts*: _____	Amps: _____
*Output breakers must be same voltage	
REMARKS:	

